




PT. MERSI BIOVAC PROINDO

**DESIGN OF SECONDARY PACKAGING
ARTWORK DESIGN STANDARD INSERT**

AW-PRD-2025-001

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:

NAME	POSITION	SIGNATURE	DATE
Diny Lucyanie	Quality Manager		27/02/2026

Approved by:

NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY

Revision	Description	Prepare by	Date
0	New Version	Production	26 Nov 2025
1	1. Add the pharma code 2. Change manufactured by and material code	Production	

ARTWORK DESIGN STANDARD INSERT

FORMENING

Size (L x W) 150 x 85 mm

Material	
HVS Paper 60g	
PackSize/Primary	
Vial @ 200 µg + 1 vial pelarut @ 0.5 mL	
Primary	
Vial & Ampul	
No. Reg	
XXXXXXXXXXXX	

Front / Back	Type Font	
	Product Name	Another Font
	Helvetica Narrow, Bold	Helvetica Narrow
	5.6pt	4.2pt

		19 x 3,4mm (LxH)	TEXT Black	Material Code	LIS26301

CHECKED & APPROVED BY						
	R&D	RA			BIO/VAC	
	Type	Type	Type	Type	Type	Type
Signature	Manager	Supervisor	Manager	Cat. Spec. Dir.	Marketing	Researcher

Front Side

FORMENID®

COMPOSITION

Each 100 mg tablet contains: 100 mg of Formenid® (Formenid®) active ingredient.
 100 mg of Formenid® (Formenid®) active ingredient.
 100 mg of Formenid® (Formenid®) active ingredient.
 100 mg of Formenid® (Formenid®) active ingredient.

INDICATIONS

Formenid® is indicated for the treatment of the following conditions:

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke (brain attack).
7. Peripheral vascular disease (PVD).
8. Diabetes mellitus (sugar disease).
9. Gout (joint pain).
10. Rheumatoid arthritis (joint inflammation).
11. Osteoarthritis (joint wear and tear).
12. Osteoporosis (bone density loss).
13. Osteopenia (low bone density).
14. Osteomalacia (soft bones).
15. Osteoporosis (bone density loss).
16. Osteopenia (low bone density).
17. Osteomalacia (soft bones).
18. Osteoporosis (bone density loss).
19. Osteopenia (low bone density).
20. Osteomalacia (soft bones).

CONTRAINDICATIONS

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke (brain attack).
7. Peripheral vascular disease (PVD).
8. Diabetes mellitus (sugar disease).
9. Gout (joint pain).
10. Rheumatoid arthritis (joint inflammation).
11. Osteoarthritis (joint wear and tear).
12. Osteoporosis (bone density loss).
13. Osteopenia (low bone density).
14. Osteomalacia (soft bones).
15. Osteoporosis (bone density loss).
16. Osteopenia (low bone density).
17. Osteomalacia (soft bones).
18. Osteoporosis (bone density loss).
19. Osteopenia (low bone density).
20. Osteomalacia (soft bones).

DOSE (mg/kg)

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke (brain attack).
7. Peripheral vascular disease (PVD).
8. Diabetes mellitus (sugar disease).
9. Gout (joint pain).
10. Rheumatoid arthritis (joint inflammation).
11. Osteoarthritis (joint wear and tear).
12. Osteoporosis (bone density loss).
13. Osteopenia (low bone density).
14. Osteomalacia (soft bones).
15. Osteoporosis (bone density loss).
16. Osteopenia (low bone density).
17. Osteomalacia (soft bones).
18. Osteoporosis (bone density loss).
19. Osteopenia (low bone density).
20. Osteomalacia (soft bones).

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke (brain attack).
7. Peripheral vascular disease (PVD).
8. Diabetes mellitus (sugar disease).
9. Gout (joint pain).
10. Rheumatoid arthritis (joint inflammation).
11. Osteoarthritis (joint wear and tear).
12. Osteoporosis (bone density loss).
13. Osteopenia (low bone density).
14. Osteomalacia (soft bones).
15. Osteoporosis (bone density loss).
16. Osteopenia (low bone density).
17. Osteomalacia (soft bones).
18. Osteoporosis (bone density loss).
19. Osteopenia (low bone density).
20. Osteomalacia (soft bones).

How to take Formenid®

Formenid® (mg/kg)	Age	Sex	Height
100	18-24	M	5' 0" - 5' 6"
100	25-34	M	5' 0" - 5' 6"
100	35-44	M	5' 0" - 5' 6"
100	45-54	M	5' 0" - 5' 6"
100	55-64	M	5' 0" - 5' 6"
100	65-74	M	5' 0" - 5' 6"
100	75+	M	5' 0" - 5' 6"
100	18-24	F	5' 0" - 5' 6"
100	25-34	F	5' 0" - 5' 6"
100	35-44	F	5' 0" - 5' 6"
100	45-54	F	5' 0" - 5' 6"
100	55-64	F	5' 0" - 5' 6"
100	65-74	F	5' 0" - 5' 6"
100	75+	F	5' 0" - 5' 6"

NOTE: Formenid® is not recommended for use in children under 18 years of age.

WARNINGS AND PRECAUTIONS

1. Avoid use in patients with a history of heart failure or other conditions that may affect the heart.
2. Avoid use in patients with a history of liver or kidney disease.
3. Avoid use in patients with a history of low blood pressure.
4. Avoid use in patients with a history of low blood pressure.
5. Avoid use in patients with a history of low blood pressure.
6. Avoid use in patients with a history of low blood pressure.
7. Avoid use in patients with a history of low blood pressure.
8. Avoid use in patients with a history of low blood pressure.
9. Avoid use in patients with a history of low blood pressure.
10. Avoid use in patients with a history of low blood pressure.
11. Avoid use in patients with a history of low blood pressure.
12. Avoid use in patients with a history of low blood pressure.
13. Avoid use in patients with a history of low blood pressure.
14. Avoid use in patients with a history of low blood pressure.
15. Avoid use in patients with a history of low blood pressure.
16. Avoid use in patients with a history of low blood pressure.
17. Avoid use in patients with a history of low blood pressure.
18. Avoid use in patients with a history of low blood pressure.
19. Avoid use in patients with a history of low blood pressure.
20. Avoid use in patients with a history of low blood pressure.

Effects

1. Avoid use in patients with a history of heart failure or other conditions that may affect the heart.
2. Avoid use in patients with a history of liver or kidney disease.
3. Avoid use in patients with a history of low blood pressure.
4. Avoid use in patients with a history of low blood pressure.
5. Avoid use in patients with a history of low blood pressure.
6. Avoid use in patients with a history of low blood pressure.
7. Avoid use in patients with a history of low blood pressure.
8. Avoid use in patients with a history of low blood pressure.
9. Avoid use in patients with a history of low blood pressure.
10. Avoid use in patients with a history of low blood pressure.
11. Avoid use in patients with a history of low blood pressure.
12. Avoid use in patients with a history of low blood pressure.
13. Avoid use in patients with a history of low blood pressure.
14. Avoid use in patients with a history of low blood pressure.
15. Avoid use in patients with a history of low blood pressure.
16. Avoid use in patients with a history of low blood pressure.
17. Avoid use in patients with a history of low blood pressure.
18. Avoid use in patients with a history of low blood pressure.
19. Avoid use in patients with a history of low blood pressure.
20. Avoid use in patients with a history of low blood pressure.

Contraindications

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke (brain attack).
7. Peripheral vascular disease (PVD).
8. Diabetes mellitus (sugar disease).
9. Gout (joint pain).
10. Rheumatoid arthritis (joint inflammation).
11. Osteoarthritis (joint wear and tear).
12. Osteoporosis (bone density loss).
13. Osteopenia (low bone density).
14. Osteomalacia (soft bones).
15. Osteoporosis (bone density loss).
16. Osteopenia (low bone density).
17. Osteomalacia (soft bones).
18. Osteoporosis (bone density loss).
19. Osteopenia (low bone density).
20. Osteomalacia (soft bones).

DOSE (mg/kg)

1. Hypertension (high blood pressure).
2. Angina pectoris (chest pain).
3. Myocardial infarction (heart attack).
4. Coronary artery disease (CAD).
5. Heart failure (weak heart).
6. Stroke

Back Side

[illegible]




PT. MERSI BIOVAC PROINDO

**DESIGN OF SECONDARY PACKAGING
ARTWORK DESIGN STANDARD ISOLASI PRINTED**

AW-PRD-2025-002

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:

NAME	POSITION	SIGNATURE	DATE
Diny Lucyanie	Quality Manager		27/02/2026

Approved by:


NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY

Revision	Description	Prepare by	Date
0	New Version	Production	26 Nov 2026
1	Change logo to Mersi Biovac	Production	

SELOTAPE					
Size (L x W) 20 x 12					
OPC Film (Microns)	Colour	Thickness (Glad mm)			
OPC Film (20microns)	Clear	0.04mm			
			Type Font	Front / Rear Panel	
			Multimedia		
			Logo	Size (LxH)	
			Anti-Static	Colour	
			16 x 2.3 mm	Blue	
			3-ply	Orange	
				Black	
				White	

SWEET CHEN

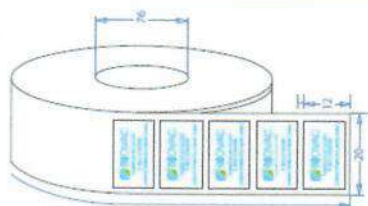

Diameter
Max 350 mm

Logo - scale 200%
Preview - Dimensions in mm

Logo Actual size - Scale 100 %

COURT & AFFIDAVIT BY				
STATE	COUNTY	CITY	DATE	BY
MD	ST	MD	MD	MD

NOTE: HANYA DIGUNAKAN UNTUK FAT, SAT, IQ, OQ
Approval Biovac

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026
Diny Lucyanie	Quality Manager		27/02/2026
Dyah Arum Mulyaningsih	Site Head		03/03/2026

ARTWORK DESIGN STANDARD SELOTAPE PRINTED

Date of use: 27/02/2026
(DD-MM-YYYY)

SELOTAPE			
Size (L x W) 20 x 12		Front / Rear Panel	
Material	Thickness	Type Font	Logo
OPP Film25Mic-Dhesive23Mic	0.048 mm	Redational	Size (LxH)
		Arial, Bold	BIOVAC
		3.3pt	15 x 3.5 mm
			Colour
			BLUE PANTONE 310 U 10-54-02
			GREEN PANTONE 350-90 TM 10-70-02

SKETCHES

20 mm

12

20 mm

20 mm

12

76

Diameter
Max 350 mm

Logo - scale 200%
Preview - Dimensions in mm

Logo Actual size - Scale 100 %

CHECKED & APPROVED BY			
R&D	QA	QA	BIOVAC
Signature	Signature	Signature	Signature
Manager	Manager	Manager	Manager
Signature	Signature	Signature	Signature
Manager	Manager	Manager	Manager



PT. MERISI BIOVAC PROINDO

**DESIGN OF SECONDARY PACKAGING
ARTWORK DESIGN STANDARD ETIKET WATER
FOR INJECTION**

AW-PRD-2025-003

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:

NAME	POSITION	SIGNATURE	DATE
Diny Lucyanie	Quality Manager		27/02/2026

Approved by:

NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY


Revision	Description	Prepare by	Date
0	New Version	Production	26 Nov 2025
1	1. Update the design 2. Change manufactured by and material code	Production	

PT. MERSI BIOVAC
PROINDO

Date of use: 27/02/2026
(DD-MM-YYYY)

FORMENING WFI			
Size (L x W) 41 x 13 mm			
Sticker High Gloss Paper S1010 BG 40 WH	Material	Packsize/Primary Vial @ 0.5 mL	No. Reg XXXXXXXXXXXXXXXXXX
Front / Rear Panel		Type Font	
Product Name	Another Font	Another Font	
Avenir, Bold	Frobar Pro	Avenir, Regular	Bold
5pt	2.9pt	2.5pt	

ROLL PRINTED ETIKET
GAP ~ DIE CUT

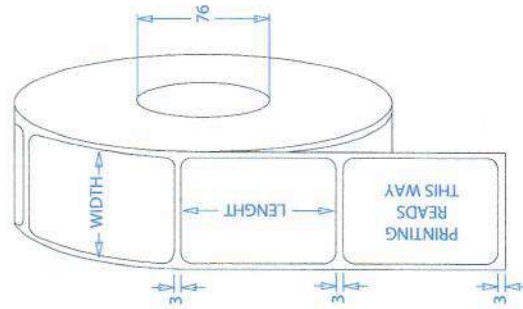

Diameter
Max 400 mm

SKETCHES



Preview Gap Roll



Actual size - Scale 100 %

Preview 200 %

	 HALAL REKREASI	PT. MERSI BIOVAC PROINDO 13 x 2.4 mm (LxH)		 BIOVAC 7 x 1.4 mm (LxH)				Finishing
		Ø5mm	3.5x 6.5mm (LxH)					

[illegible]




PT. MERSI BIOVAC PROINDO

**DESIGN OF SECONDARY PACKAGING
ARTWORK DESIGN STANDARD ETIKET
FORMENING POWDER LOGO HALAL INDONESIA**

AW-PRD-2025-004

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:

NAME	POSITION	SIGNATURE	DATE
Diny Lucyane	Quality Manager		27/02/2026

Approved by:

NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY

Revision	Description	Prepare by	Date
0	New Version	Production	26 Nov 2025
1	1. Update the design 2. Change manufactured by and material code	Production	

NOTE: HANYA DIGUNAKAN UNTUK FAT, SAT, IQ, OQ
Approval Biovac

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026
Diny Lucyanie	Quality Manager		27/02/2026
Dyah Arum Mulyaningsih	Site Head		03/03/2026

FORMENING POWDER

Size (L x W) 41 x 13 mm

Material
Sticker High Gloss Paper S1010 BG 40 WH

Packs/Size/Primary
Vial @ 0.5 mL


No. Reg	Regulation	Comments
1	1.1	1.1
2	2.1	2.1
3	3.1	3.1
4	4.1	4.1
5	5.1	5.1
6	6.1	6.1
7	7.1	7.1
8	8.1	8.1
9	9.1	9.1
10	10.1	10.1
11	11.1	11.1
12	12.1	12.1
13	13.1	13.1
14	14.1	14.1
15	15.1	15.1
16	16.1	16.1
17	17.1	17.1
18	18.1	18.1
19	19.1	19.1
20	20.1	20.1
21	21.1	21.1
22	22.1	22.1
23	23.1	23.1
24	24.1	24.1
25	25.1	25.1
26	26.1	26.1
27	27.1	27.1
28	28.1	28.1
29	29.1	29.1
30	30.1	30.1
31	31.1	31.1
32	32.1	32.1
33	33.1	33.1
34	34.1	34.1
35	35.1	35.1
36	36.1	36.1
37	37.1	37.1
38	38.1	38.1
39	39.1	39.1
40	40.1	40.1
41	41.1	41.1
42	42.1	42.1
43	43.1	43.1
44	44.1	44.1
45	45.1	45.1
46	46.1	46.1
47	47.1	47.1
48	48.1	48.1
49	49.1	49.1
50	50.1	50.1
51	51.1	51.1
52	52.1	52.1
53	53.1	53.1
54	54.1	54.1
55	55.1	55.1
56	56.1	56.1
57	57.1	57.1
58	58.1	58.1
59	59.1	59.1
60	60.1	60.1
61	61.1	61.1
62	62.1	62.1
63	63.1	63.1
64	64.1	64.1
65	65.1	65.1
66	66.1	66.1
67	67.1	67.1
68	68.1	68.1
69	69.1	69.1
70	70.1	70.1
71	71.1	71.1
72	72.1	72.1
73	73.1	73.1
74	74.1	74.1
75	75.1	75.1
76	76.1	76.1
77	77.1	77.1
78	78.1	78.1
79	79.1	79.1
80	80.1	80.1
81	81.1	81.1
82	82.1	82.1
83	83.1	83.1
84	84.1	84.1
85	85.1	85.1
86	86.1	86.1
87	87.1	87.1
88	88.1	88.1
89	89.1	89.1
90	90.1	90.1
91	91.1	91.1
92	92.1	92.1
93	93.1	93.1
94	94.1	94.1
95	95.1	95.1
96	96.1	96.1
97	97.1	97.1
98	98.1	98.1
99	99.1	99.1
100	100.1	100.1

Front / Rear Panel		
Type Font		
Product Name	Another Font	Another Font
Avenir, Bold	Footbar Pro	Avenir, Regular Bold
Spt	2.8pt	2.5pt




Date of use: 25/02/2026
(DD-MM-YYYY)

ROLL PRINTED ETIKET
GAP ~ DIE CUT

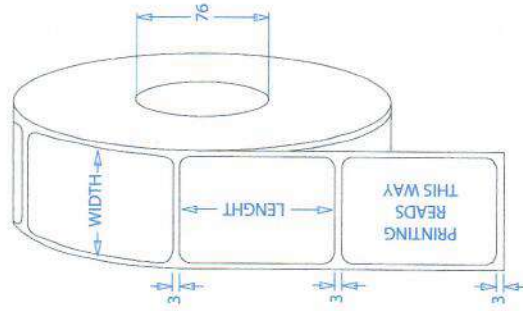

Diameter
Max 400 mm



Actual size - Scale 100 %

Preview 200 %

		PT. MERSI BIOVAC PROINDO 13 x 2.4 mm (LxH)				Material Code (Elket Powder)	Finishing	CHECKED & APPROVED BY			
								Type: _____ Typ: _____	Type: _____ Typ: _____	Type: _____ Typ: _____	Type: _____ Typ: _____
		BIOVAC 7 x 1.4 mm (LxH)				Material Code (Elket Powder)	Finishing	CHECKED & APPROVED BY			
								Type: _____ Typ: _____	Type: _____ Typ: _____	Type: _____ Typ: _____	Type: _____ Typ: _____
Ø5mm	3.5x 6.5mm (LxH)	PURPLE PANTONE TC 253.00	PURPLE PANTONE TC 253.00	RED PANTONE TC 1515	Black	LE726101	Full Varnish Waterbase	Manager Signature: _____ Date, Print, Date	Manager Signature: _____ Date, Print, Date	Manager Signature: _____ Date, Print, Date	Manager Signature: _____ Date, Print, Date



PT. MERISI BIOVAC PROINDO

DESIGN OF SECONDARY PACKAGING ARTWORK DESIGN FOLDING BOX

AW-PRD-2025-005

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:

NAME	POSITION	SIGNATURE	DATE
Diny Lucyane	Quality Manager		27/02/2026

Approved by:

NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY

Revision	Description	Prepare by	Date
0	New Version	Production	26 Nov 2025
1	1. Update the design 2. Change manufactured by and material code	Production	

NOTE: HANYA DIGUNAKAN UNTUK FAT, SAT, IQ, OQ
Approval Biovac

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026
Diny Lucyanie	Quality Manager		27/02/2026
Dyah Arum Mulyaningsih	Site Head		28/03/2026

FORMENING

Dimension (L x W x H) 43 x 20 x 67 mm

Material	Packsize/Primary	Primary	No. Reg
Ivory 300g	1 vial @ 200 µg & 1 Vial pelarut @ 0.5mL	Vial @ 1mL	XXXXXXXXXXXXXX



	No. Reg.	XXXXXX
---	----------	--------


Front / Rear Panel		Left / Right Side Panel		Top Closure Panel	Back / Rear Panel
Product Name	Type Font	Product Name	Type Font	Product Name	Type Font
Active Ingredient	Another Font	Active Ingredient	Another Font	Active Ingredient	Another Font
Footbar Pro, Bold	Footbar Pro, Bold	Avenir, Regular	Avenir, Regular	Footbar Pro, Bold	Avenir, Regular
20pt	14.5pt	8.2pt	5pt	12pt	5pt














PT. MERSI BIOVAC
PROINDO


Date of use: 27/02/2026
(DD-MM-YYYY)

SKETCHES








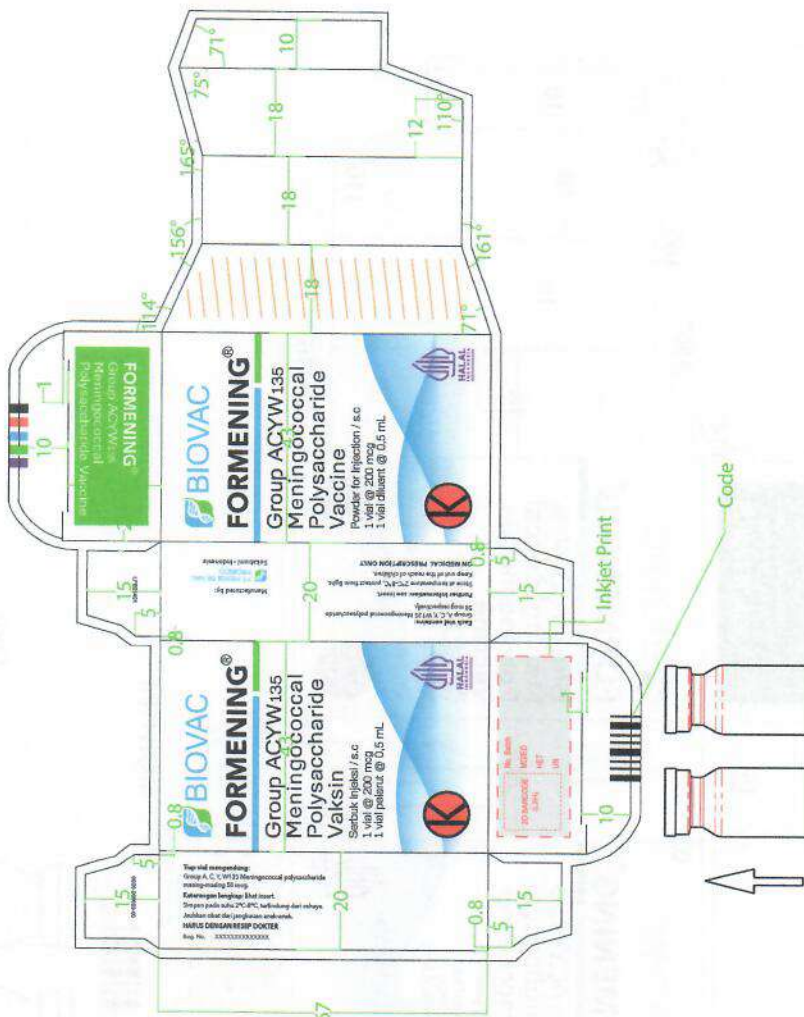



Not Actual Size - Size in mm

						Material Code
Cut						
Crease						
Outside Bleed						
Glue Flap						
Finishing: Full Varnish Type Water Base						
<div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div>














</div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div>














</div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div>














</div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div>












</div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div>





</div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div><div><div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div> | | | | | | |

[illegible]




PT. MERSI BIOVAC PROINDO

DESIGN OF SECONDARY PACKAGING ARTWORK DESIGN INNER BOX

AW-PRD-2025-006

Prepared by:

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026

Reviewed by:


NAME	POSITION	SIGNATURE	DATE
Diny Lucyane	Quality Manager		27/02/2026

Approved by:

NAME	POSITION	SIGNATURE	DATE
Dyah Arum Mulyaningsih	Site Head		03/03/2026

REVISION HISTORY

Revision	Description	Prepare by	Date
0	New Version	Production	

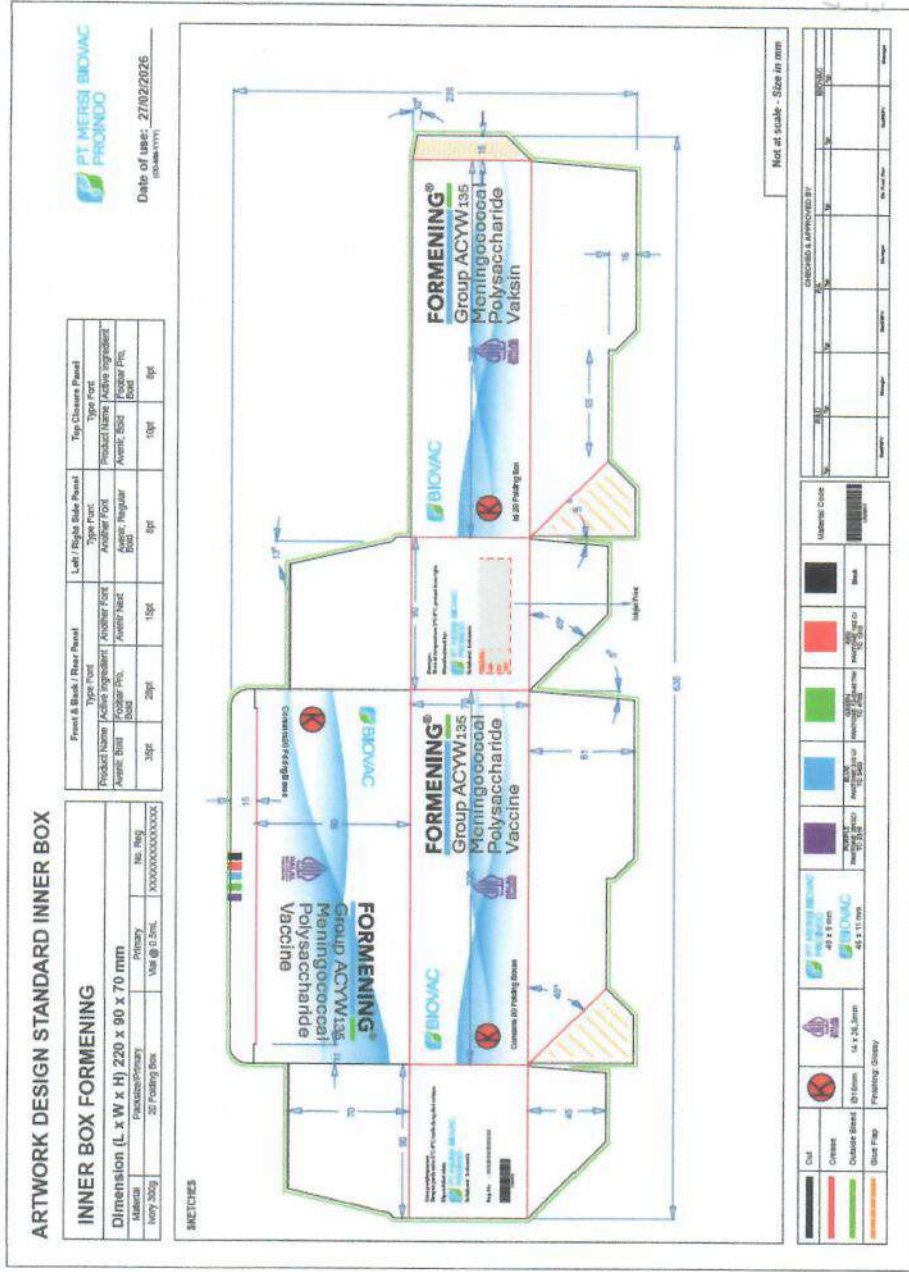

NOTE: HANYA DIGUNAKAN UNTUK FAT, SAT, IQ, OQ

Approval Biovac

NAME	POSITION	SIGNATURE	DATE
Dionisius Laffyanto	Operation Manager		27/02/2026
Diny Lucyanie	Quality Manager		27/02/2026
Dyah Arum Mulyaningsih	Site Head		03/03/2026

ARTWORK DESIGN STANDARD INNER BOX

INNER BOX FORMENING


Dimension (L x W x H) 220 x 90 x 70 mm

Material	Packsize/Primary	Primary	No. Reg
Ivory 300g	20 Folding Box	Vial @ 0.5mL	XXXXXXXXXXXXXXX

Front & Back / Rear Panel		Left / Right Side Panel		Top Closure Panel	
Product Name	Active Ingredient	Another Font	Type Font	Product Name	Active Ingredient
Aventir, Bold	Foobar Pro, Bold	Aventir, Bold	15pt	Aventir, Bold	Foobar Pro, Bold
35pt	28pt	8pt	10pt	8pt	8pt

Date of use: 27/02/2026
(DDMMYYYY)

SKETCHES

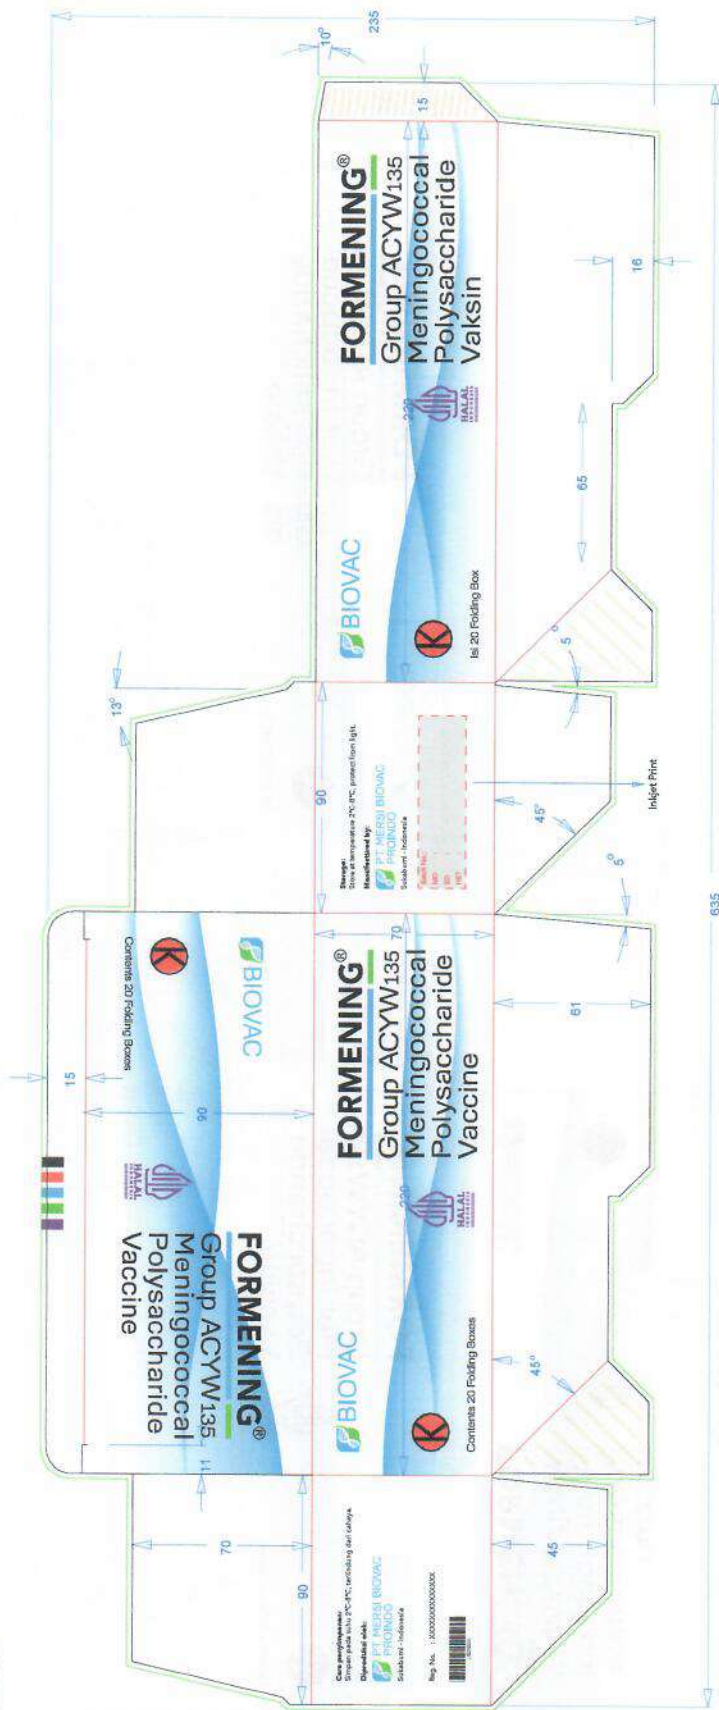

Not at scale - Size in mm

Cut		Crease		Outside Bleed		Glue Flap		Finishing: Glossy	

Checked & Approved By		RA		BIOVAC	
Signature	Signature	Signature	Signature	Signature	Signature