


1. 设计人: 王... 审核人: 李... 批准人: 张...
2. 设计日期: 2025.10.25
3. 审核日期: 2025.10.25
4. 批准日期: 2025.10.25
5. 设计单位: 上海...
6. 审核单位: 上海...
7. 批准单位: 上海...



NOTE:
1 The specific connection of the city water pipeline in the room should be confirmed by the equipment manufacturer or the installation company after their secondary design.

TOTAL POU OF CLEAN WATER			
LT. 1 EQUIP	4 POU	CU, AUTOCLAVE, LYO	
LT. 1 PROD	6 POU	SINK MUSHOLLA, LAUNDRY, CHANGING	
LT. 1 WH	4 POU	SINK MUSHOLLA, JANITOR, CHANGING	
LT. 2 EQUIP	5 POU	AUTOCLAVE, WASHING, EW	
LT. 2 LAB MICRO	5 POU	SINK, MUSHOLLA, LAB BENCH, CHANGING, JANITOR	
LT. 2 LAB P.CHEM	5 POU	SINK, MUSHOLLA, JANITOR, CHANGING	
TOTAL POU		32 POU	(~8 POU)

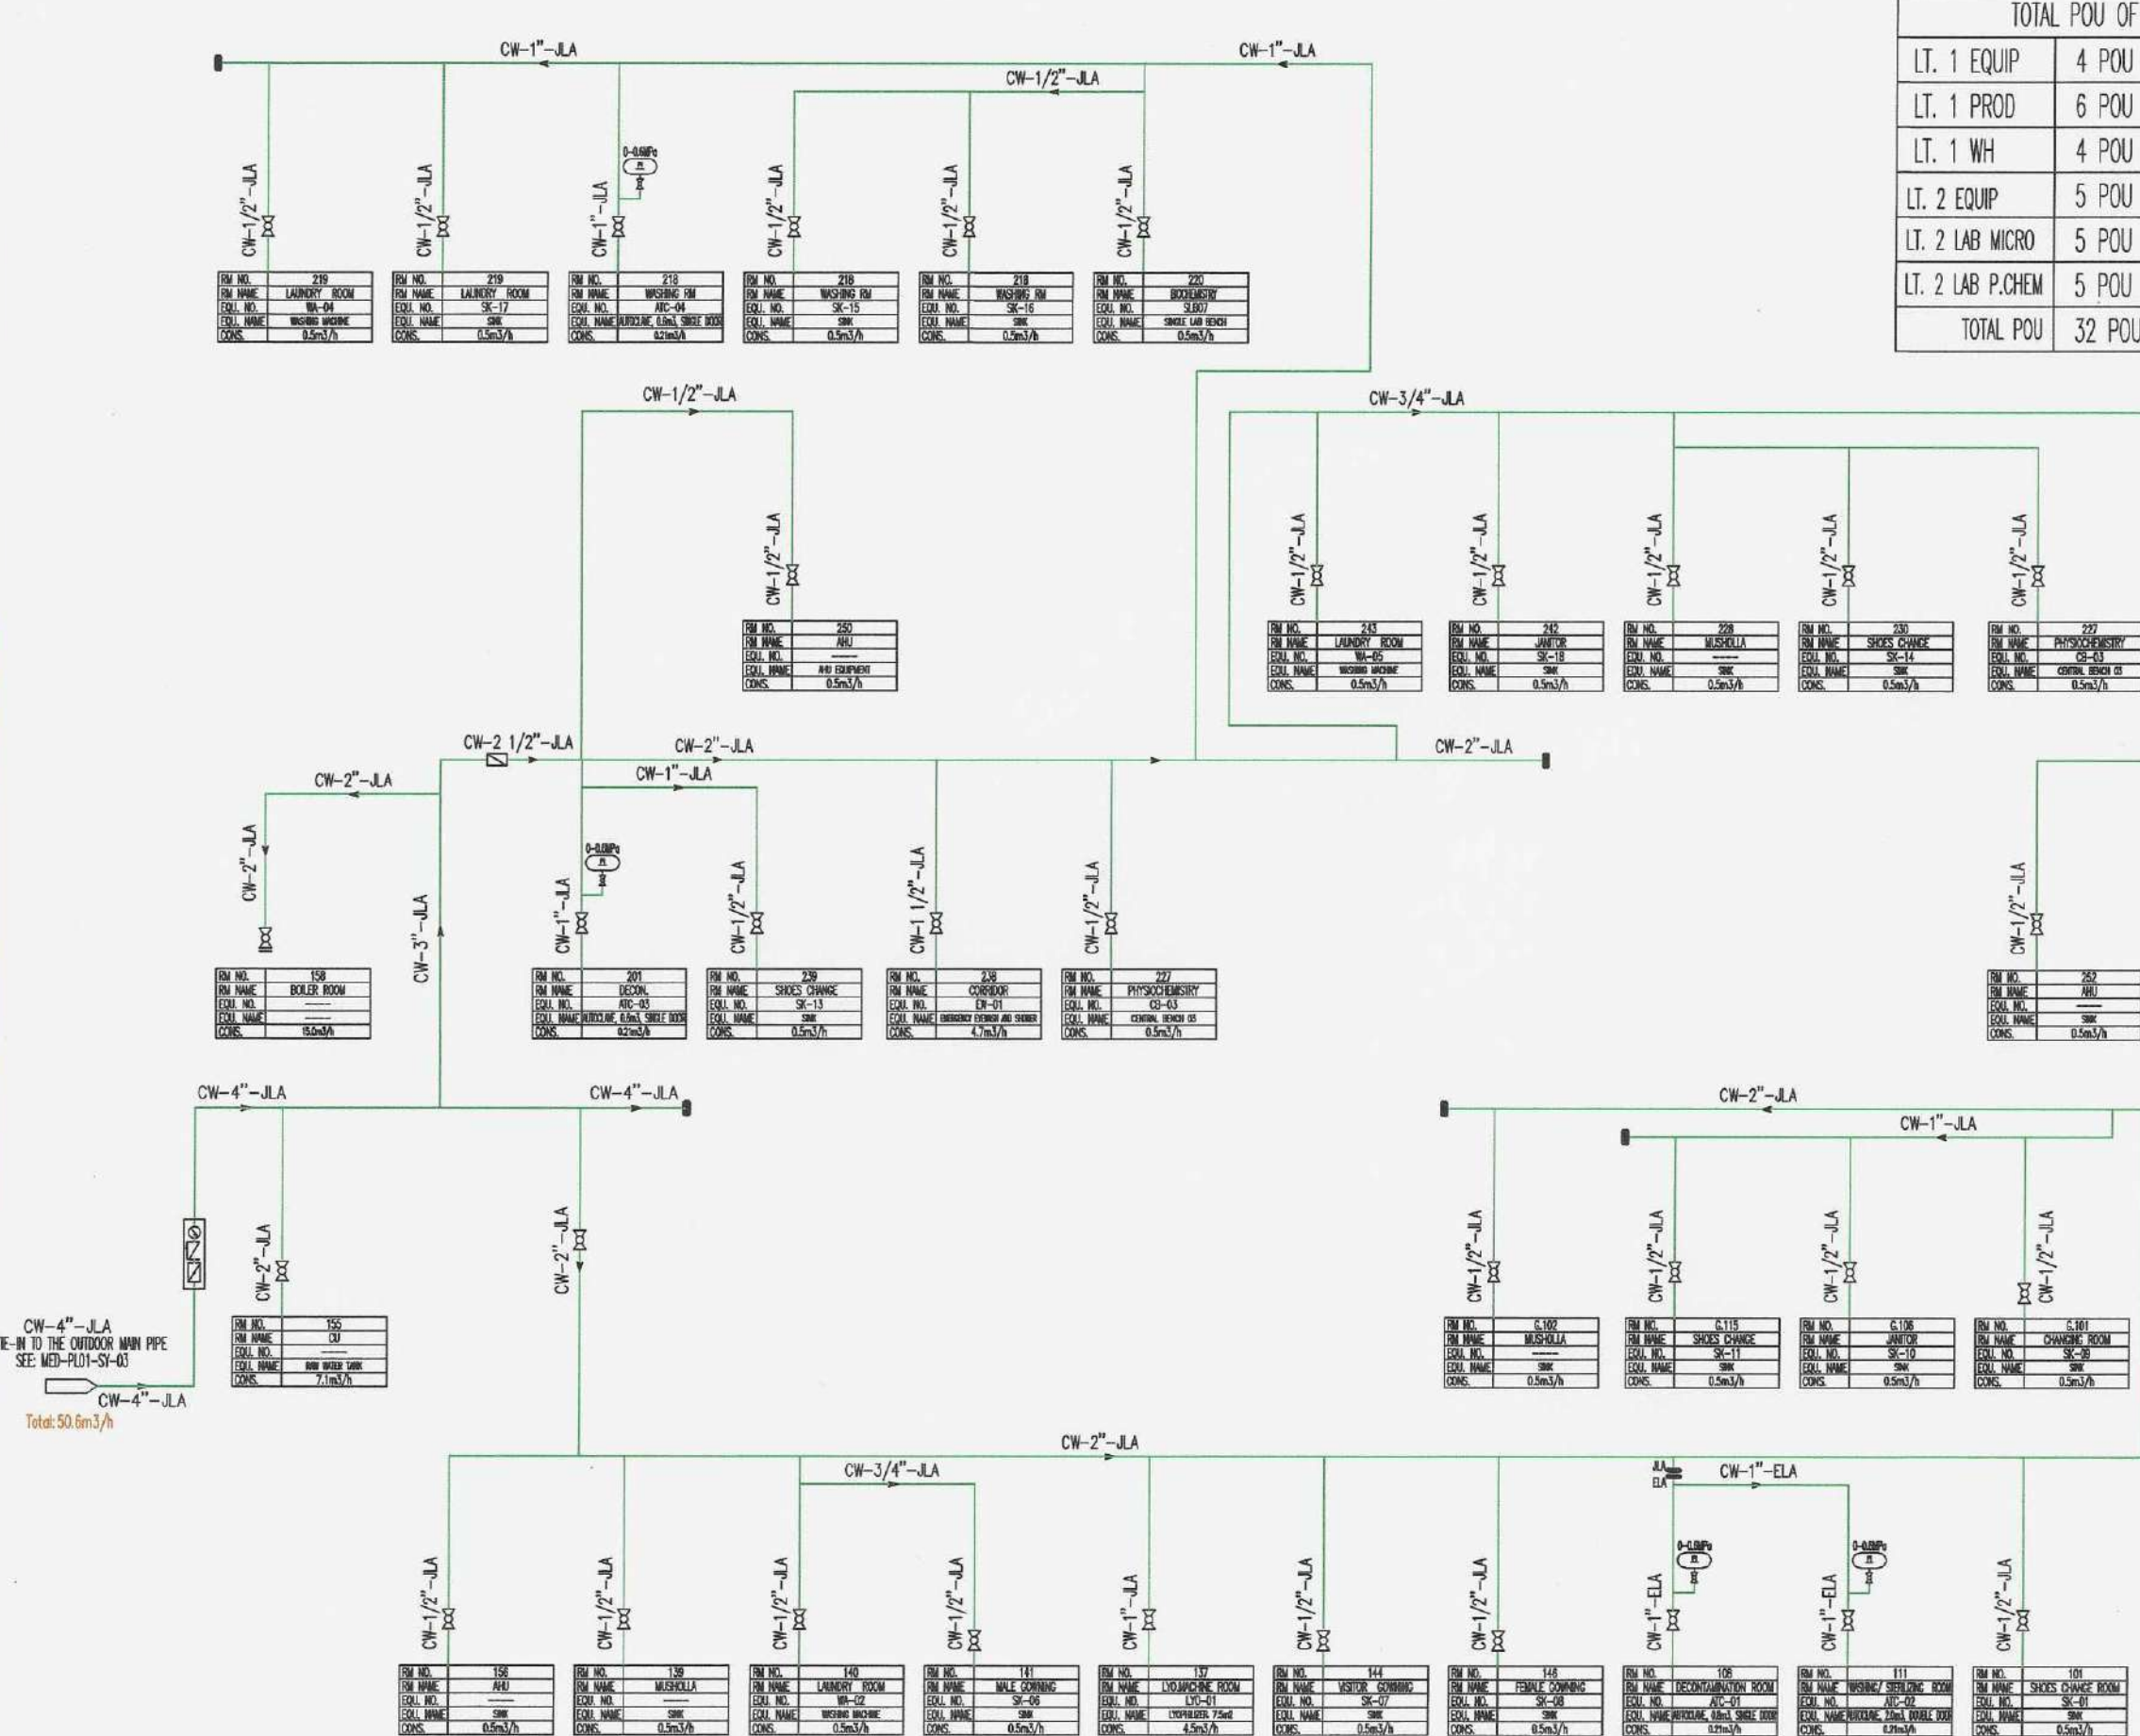

0	DETAILED DESIGN	2025.10
REV.	DESCRIPTION	DATE

注册?? 印章 REGISTERED STAMP

注册?? 印章
Professional Engineer
出? 印章 PRINT STAMP

?? 位 DESIGNER
上海...
The IT Electronics Research Design & Research Institute
Scientific and Technological Engineering Corporation Ltd.
中国 成都 高新区...
16. 251 Shengxin Rd, Xishui Avenue, Chengdu, China
71-000000

建?? 位 OWNER
PT MERSI BIOVAC PRINDO

? 目名称 PROJECT NAME
Conceptual, Basic and Detailed Design of Vaccine Manufacturing Plant

? 名称 DRAWING TITLE:
Vaccine Building

City Water Distribution System Piping Flow Diagram
REV.01

Designed By	Wu Youhe	Project No.	2024-01-004
Checked By	Ran Maoyu	Disc. Stage	DD
Reviewed By	Song Yang	Discipline	PP
Approved By	Song Yang	Scale	-
Design Number	Song Yang	Sheet No.	10
Project Name	Zhang Dongfang	Sheet No.	
Drawing No.	MED-PP01-SP-05		



+1.10

2/2 30/-26
0512

Chen Y	Wang X	Peng G	
Chen Y	Pan M	Bao S	DD
Song Y	Song Y	Chen P	PP
Agarwal A		Shi H	t:100
Song Y	Song Y	Shi H	14
Song Y	Song Y		
Drilling Co.	MED-PP01-PQ01-02		

